
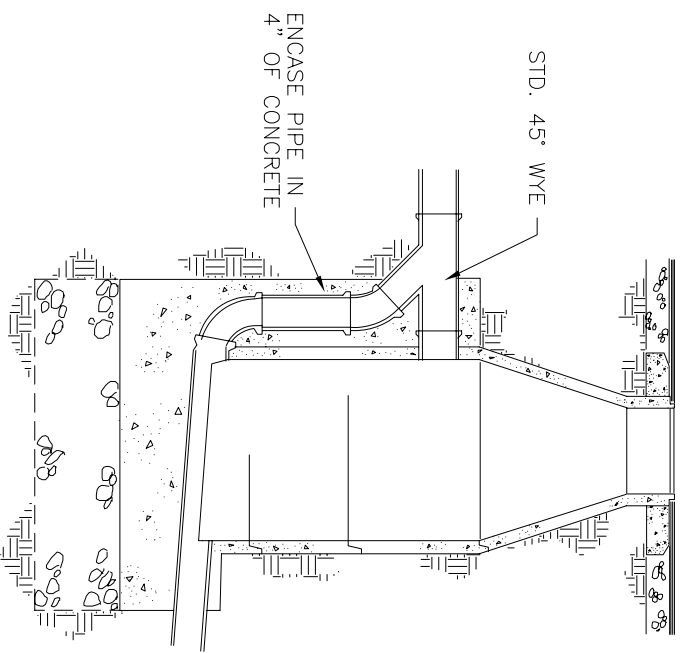


Minden-Gardnerville Sanitation District

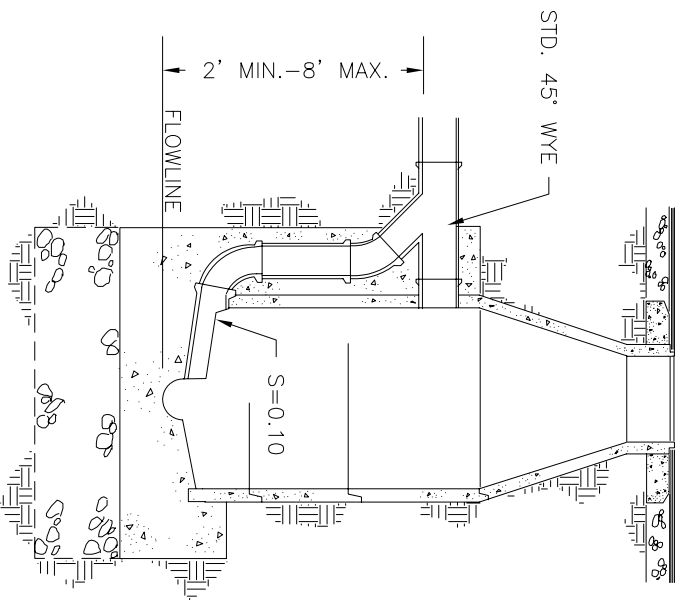

LATERAL TO MAIN

MAIN TO MAIN

NOTES:

1. DROP MANHOLES ARE TO BE USED ON ALL SANITARY SEWERS WITH MORE THAN 2 FEET VERTICAL DROP AT MANHOLE (DROP SHALL NOT EXCEED 8 FEET AT ANY MANHOLE).
2. MAINS SHALL BE SLOPED TO FALL AT LEAST 0.1 FEET ACROSS MANHOLE SECTION.
3. ALL OTHER DIMENSIONS, NOTES AND REQUIREMENTS AS SHOWN ON THE STANDARD MANHOLE DETAIL SHALL APPLY TO DROP MANHOLES.
4. DIMENSIONS NOT SHOWN ARE GIVEN ON STANDARD MANHOLE DETAIL.
5. ALL JOINTS AND CONNECTIONS TO NEW OR EXISTING MANHOLES SHALL BE WATERTIGHT.

DROP MANHOLE DETAIL C