


Minden-Gardnerville Sanitation District

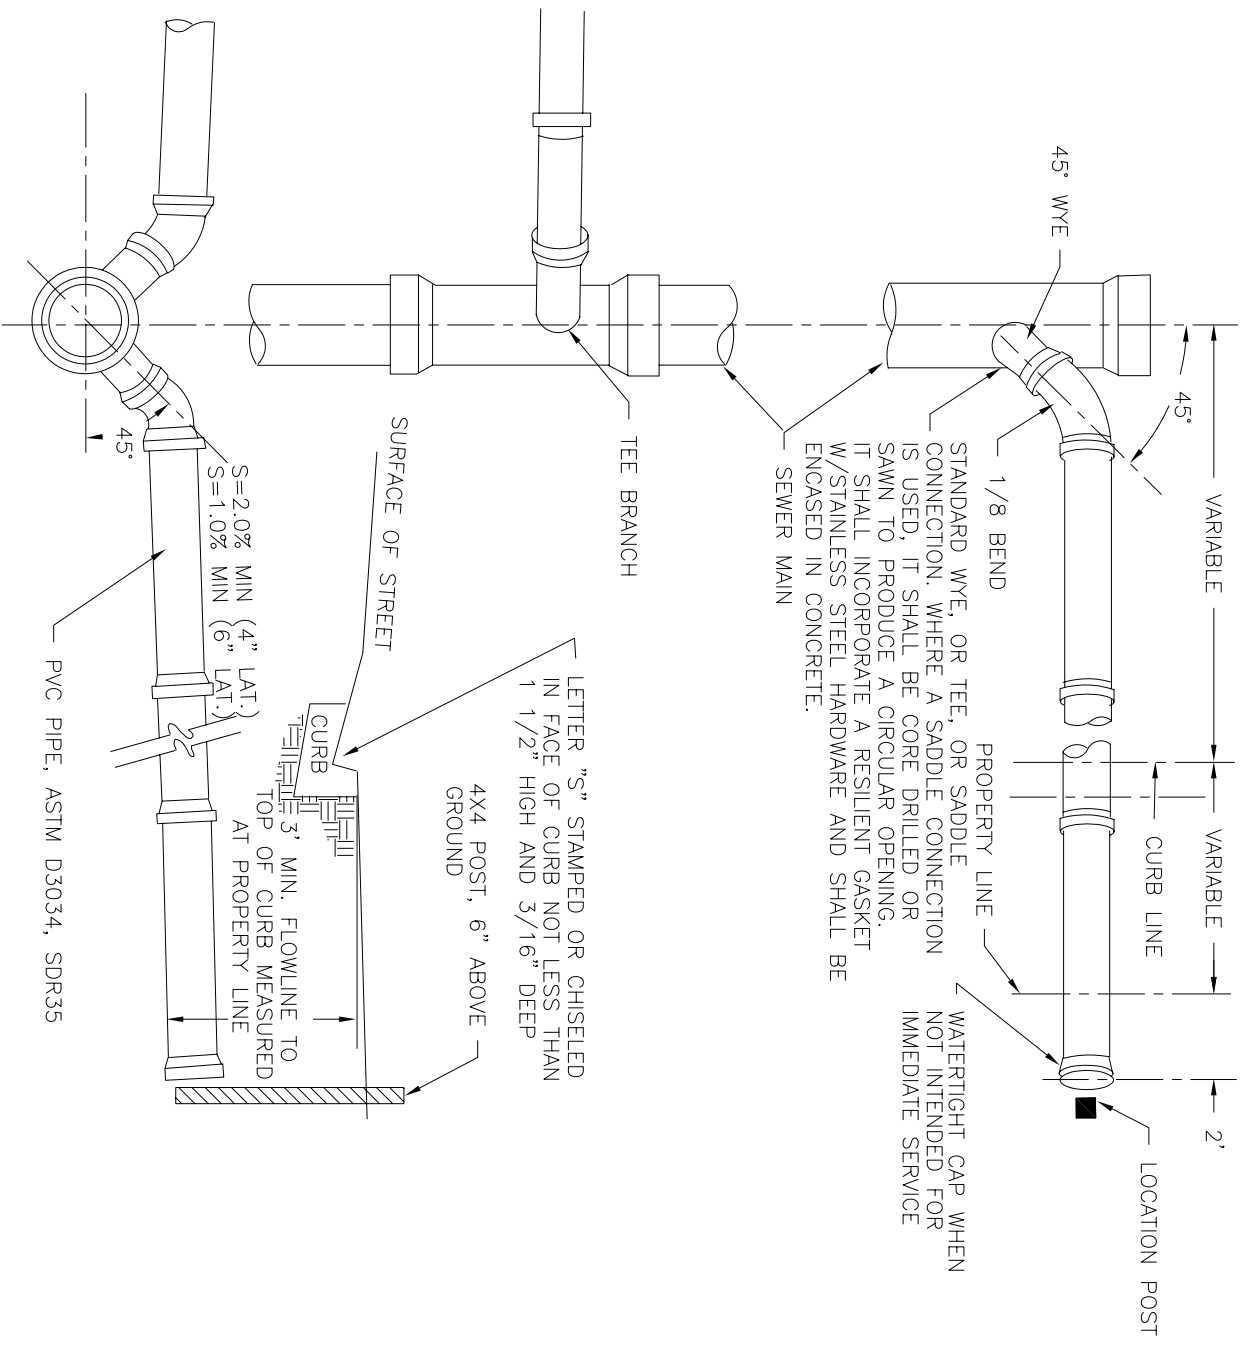

- NOTES:
1. ALL JOINTS AND CONNECTIONS SHALL BE WATERTIGHT.
 2. ALL BUILDING SEWERS SHALL HAVE A MINIMUM GROUND COVER OF TWO FEET (2') OVER THE TOP OF THE PIPE.

TYPICAL SEWER LATERAL DETAIL D

July, 2003

RESOURCE CONCEPTS, INC.